



CURB WALL AND PAVEMENT

4 THE OUTSIDE FACE OF ALL WALLS SHALL HAVE A HORIZONTAL SIMULATED BRICK PATTERN

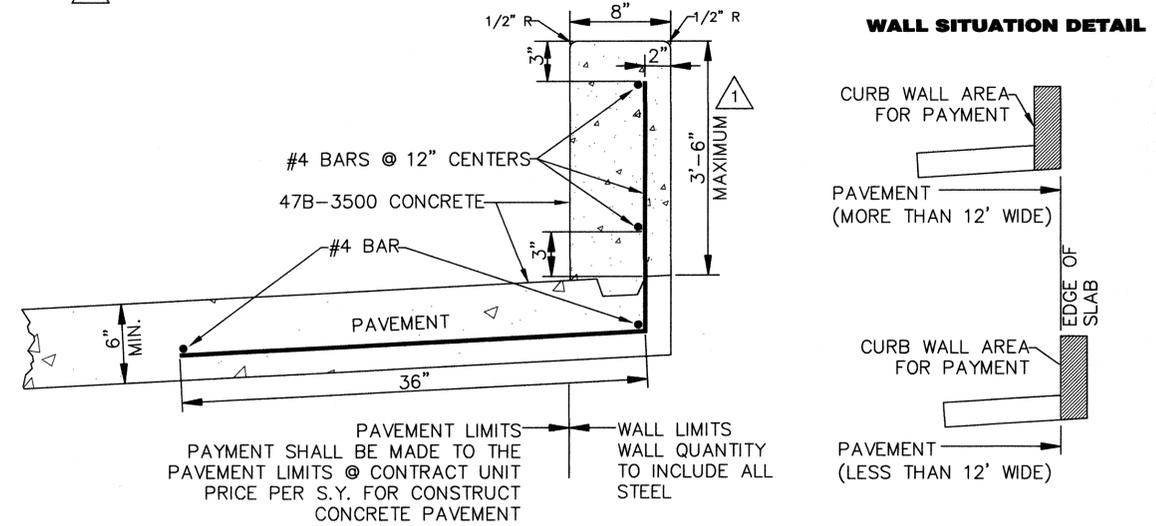

SIDEWALK CURB WALL

2 SIDEWALK PAY ITEM SQ. FT.
CURB WALL PAY ITEM SQ. FT.

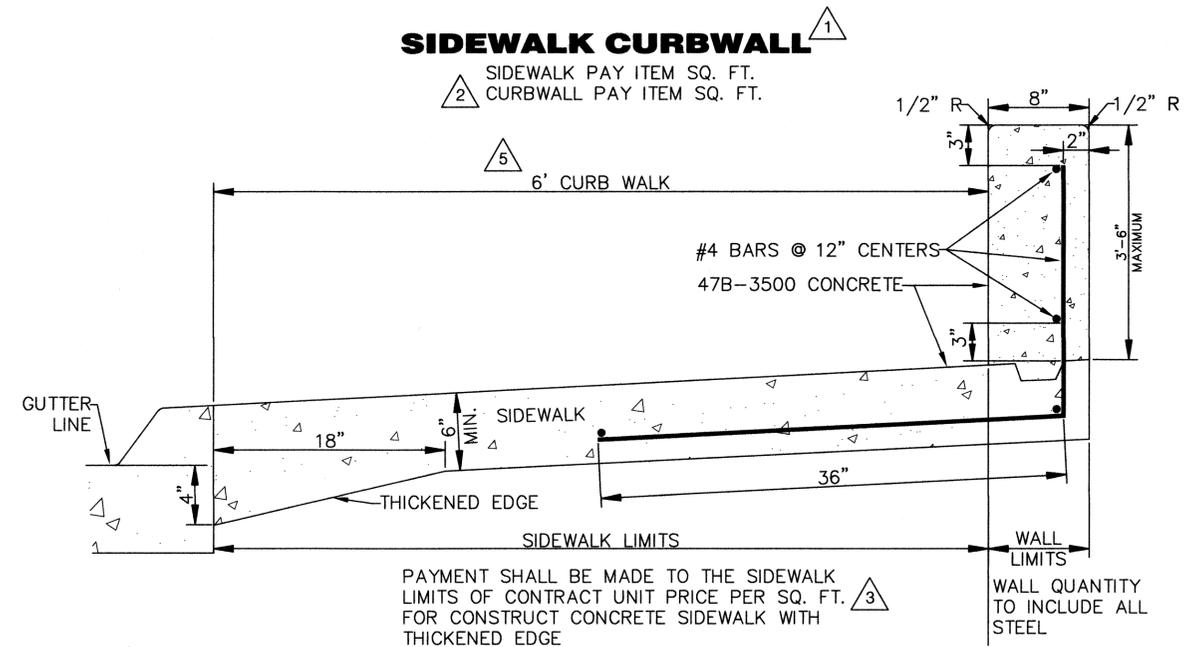

4 THE OUTSIDE FACE OF ALL WALLS SHALL HAVE A HORIZONTAL SIMULATED BRICK PATTERN.

NOTES:

1. ALL REINFORCING STEEL SHALL BE PLACED AS SHOWN WITH 2" (MINIMUM) CLEARANCE.
2. KEY WAY SHALL BE 1.5" X 3.5" AND BEVELED AS SHOWN.
3. ALL WORK AND MATERIALS SHALL CONFORM TO SECTION 6:01 OF THE STANDARD SPECIFICATIONS EXCEPT AS FOLLOWS:
 - a. SUBGRADE REQUIREMENTS NOT APPLICABLE.
 - b. SEPARATION JOINTS SHALL BE PLACED IN LINE WITH EVERY SECOND TRANSVERSE JOINT IN THE ADJOINING SLAB USING THE SPECIFIED STEEL TEMPLATE.
 - c. EXPANSION JOINTS IN THE ADJOINING PAVEMENT SHALL BE CARRIED CONTINUOUSLY THROUGH THE WALL.
 - d. PAYMENT SHALL BE MADE AT THE CONTRACT UNIT PRICE PER SQ. FT. FOR CONSTRUCT CURB WALL

1	REVISION 03/1970	4	REVISION 03/1973	City Engineer DATE 1/3/12	CITY OF OMAHA PUBLIC WORKS DEPARTMENT CURB WALL DETAIL	STANDARD PLATE 684	SHEET 1/1
2	REVISION 05/1971	5	REVISION 12/2011				
3	REVISION 09/1971						
					ISSUE DATE: ... MARCH 12, 1970		