
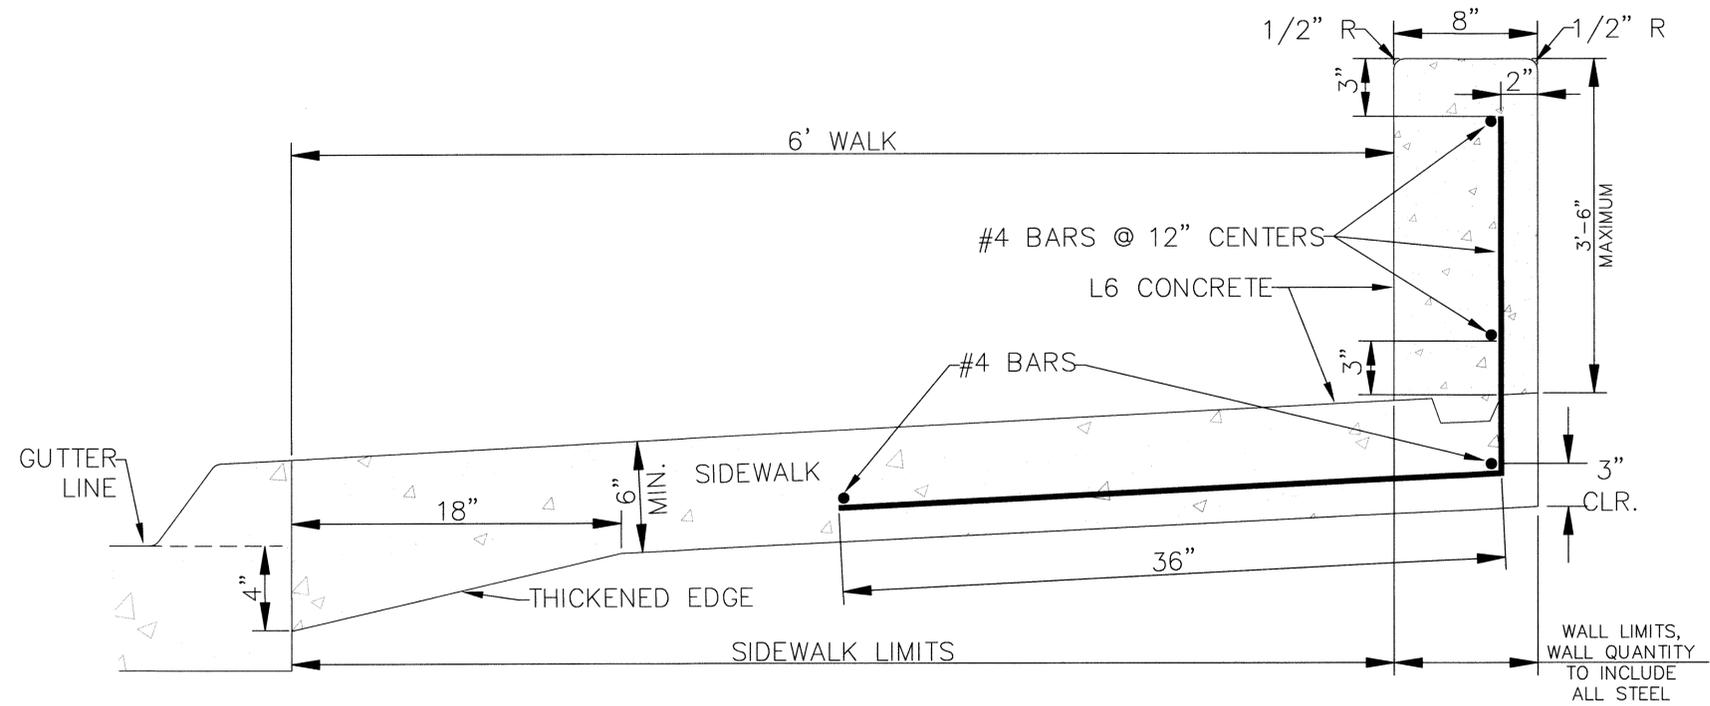


# SIDEWALK CURBWALL



### NOTES

1. ALL REINFORCING STEEL SHALL BE PLACED AS SHOWN WITH 2" CLEARANCE.
2. KEY WAY SHALL BE 1.5" X 3.5" AND BEVELED AS SHOWN.
3. ALL WORK AND MATERIALS SHALL CONFORM TO SECTION 500 OF THE STANDARD SPECIFICATIONS.
4. REINFORCING SHALL BE PLACED WITH A TOLERANCE OF -1/4" AND +1/2" ON CLEARANCE.

	 DESIGN ENGINEER	CITY OF OMAHA	PUBLIC WORKS DEPARTMENT
	 CITY ENGINEER	<b>CURB WALL</b>	<b>STANDARD PLATE 600-06</b> SHEET 1/1 ISSUE DATE: ... DECEMBER 10, 2013